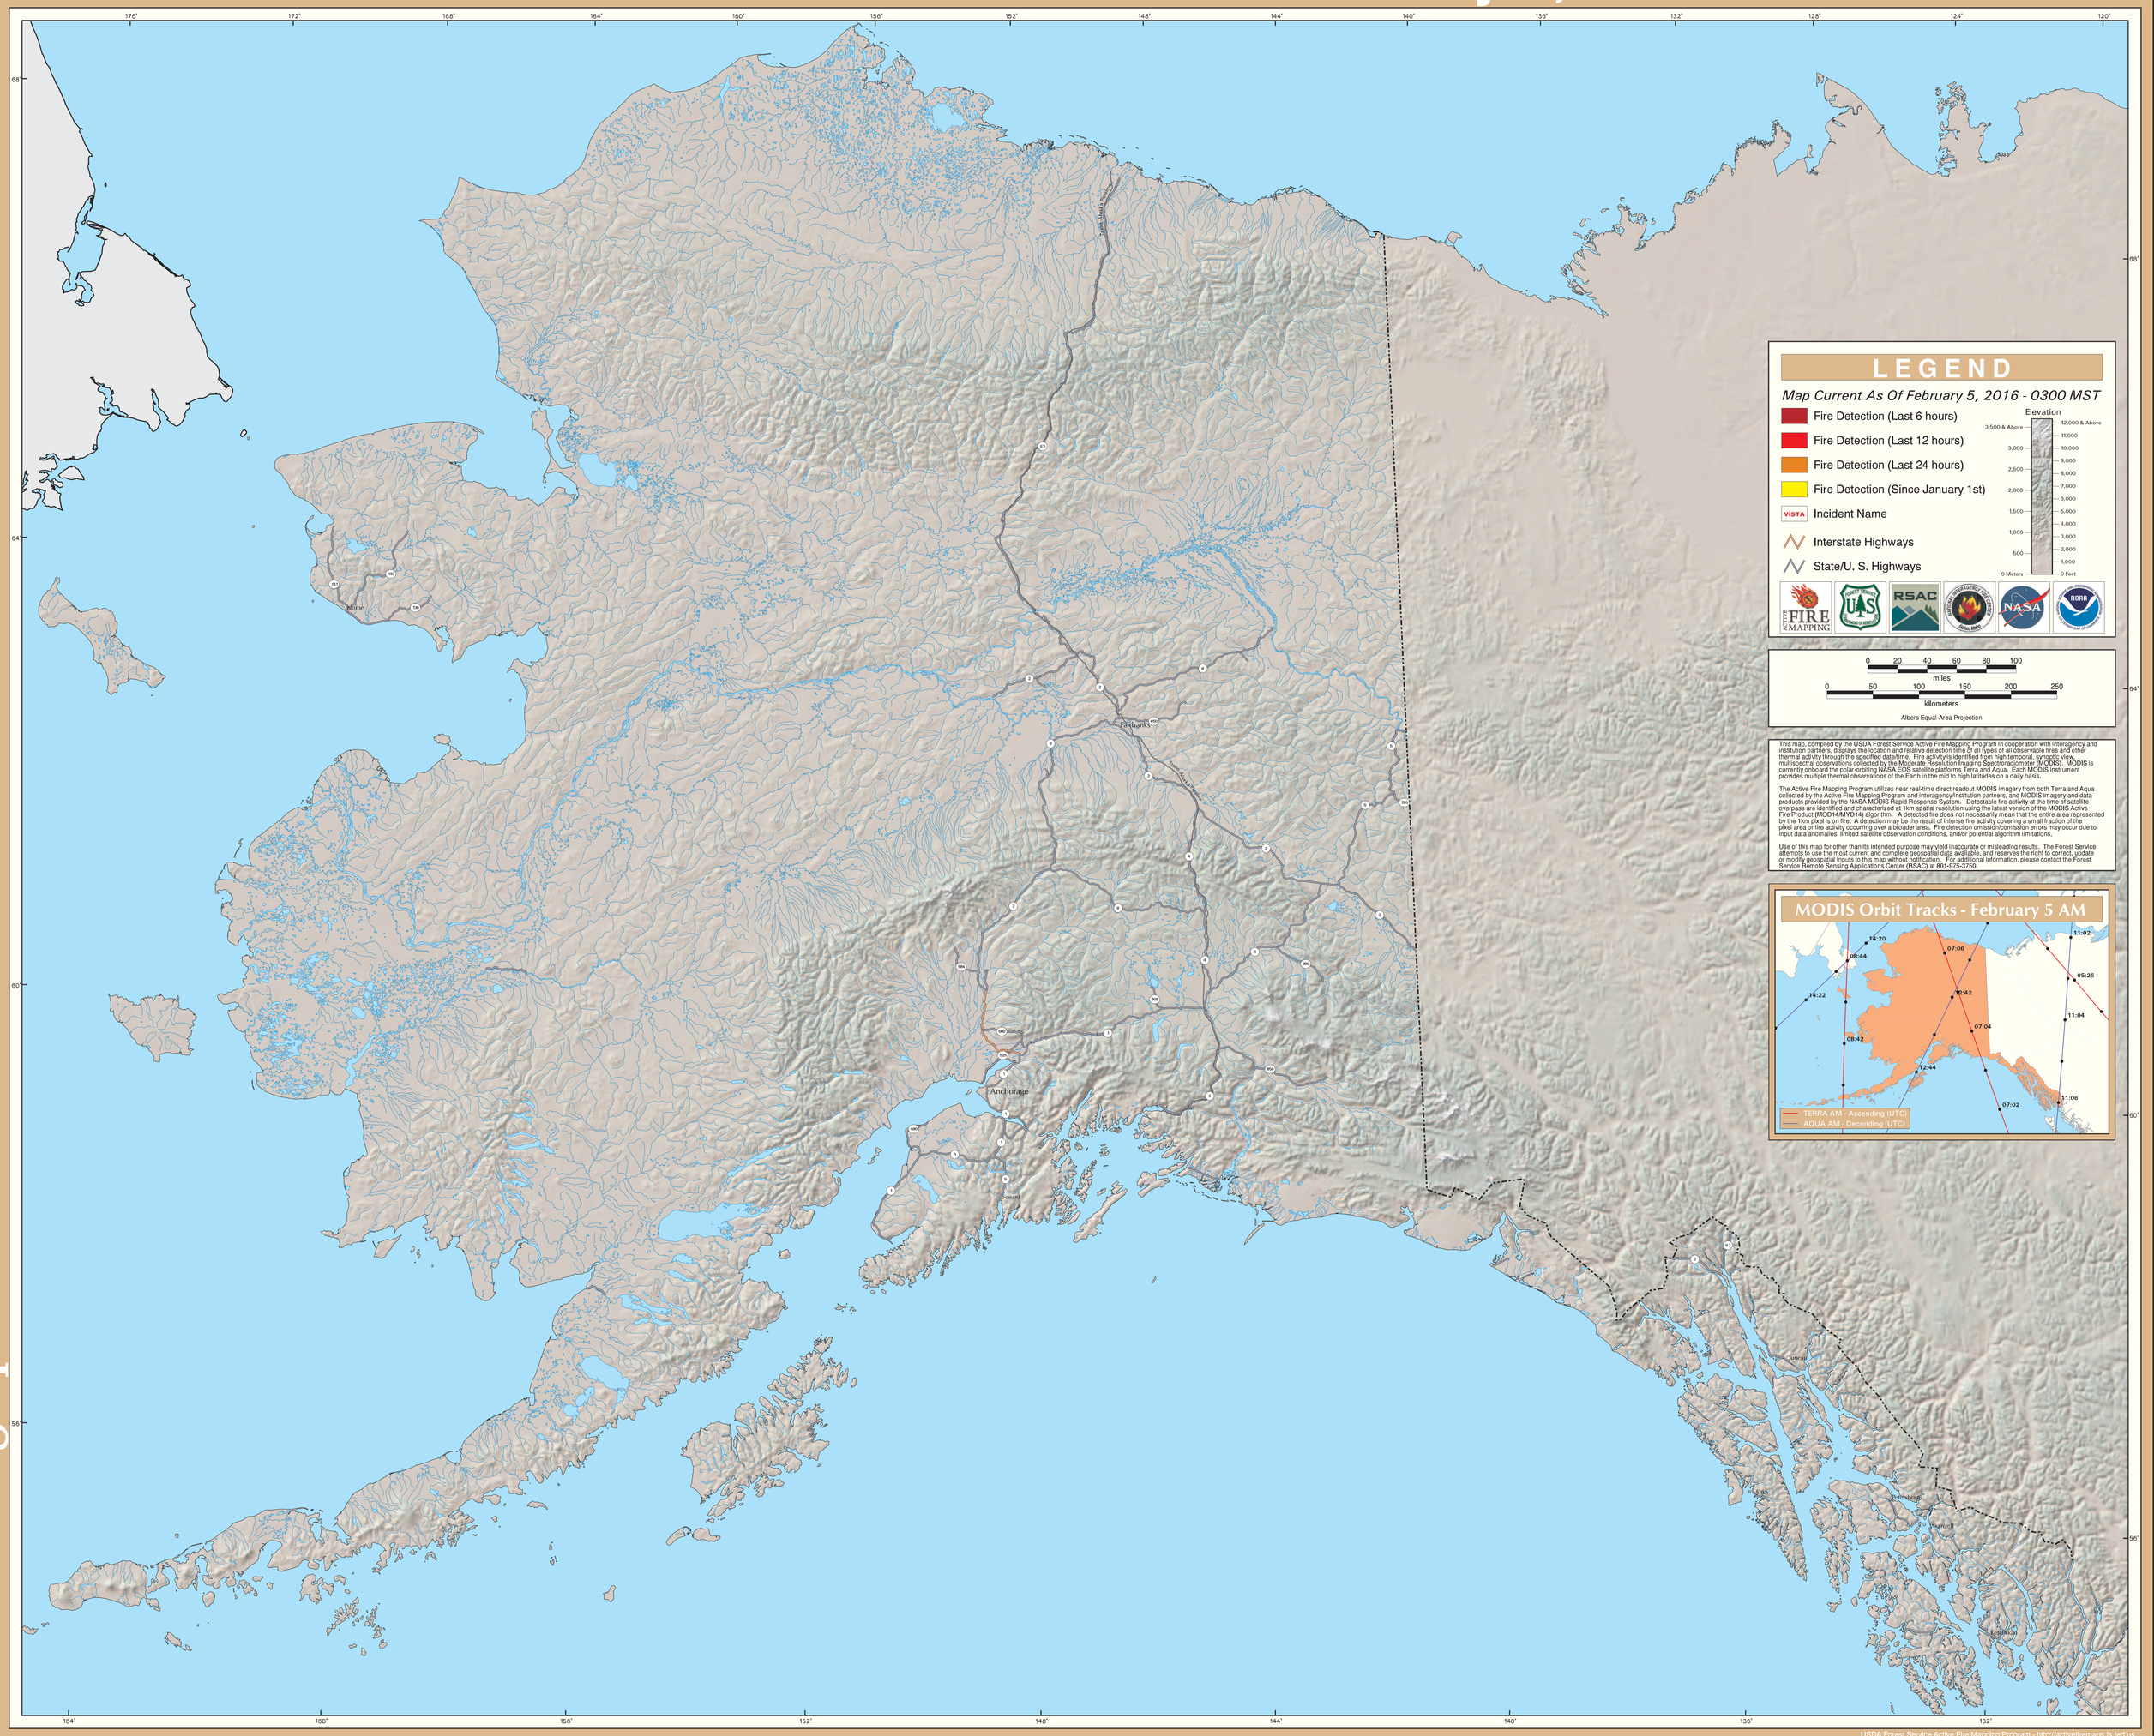MODIS Active Fire Detections - February 5, 2016