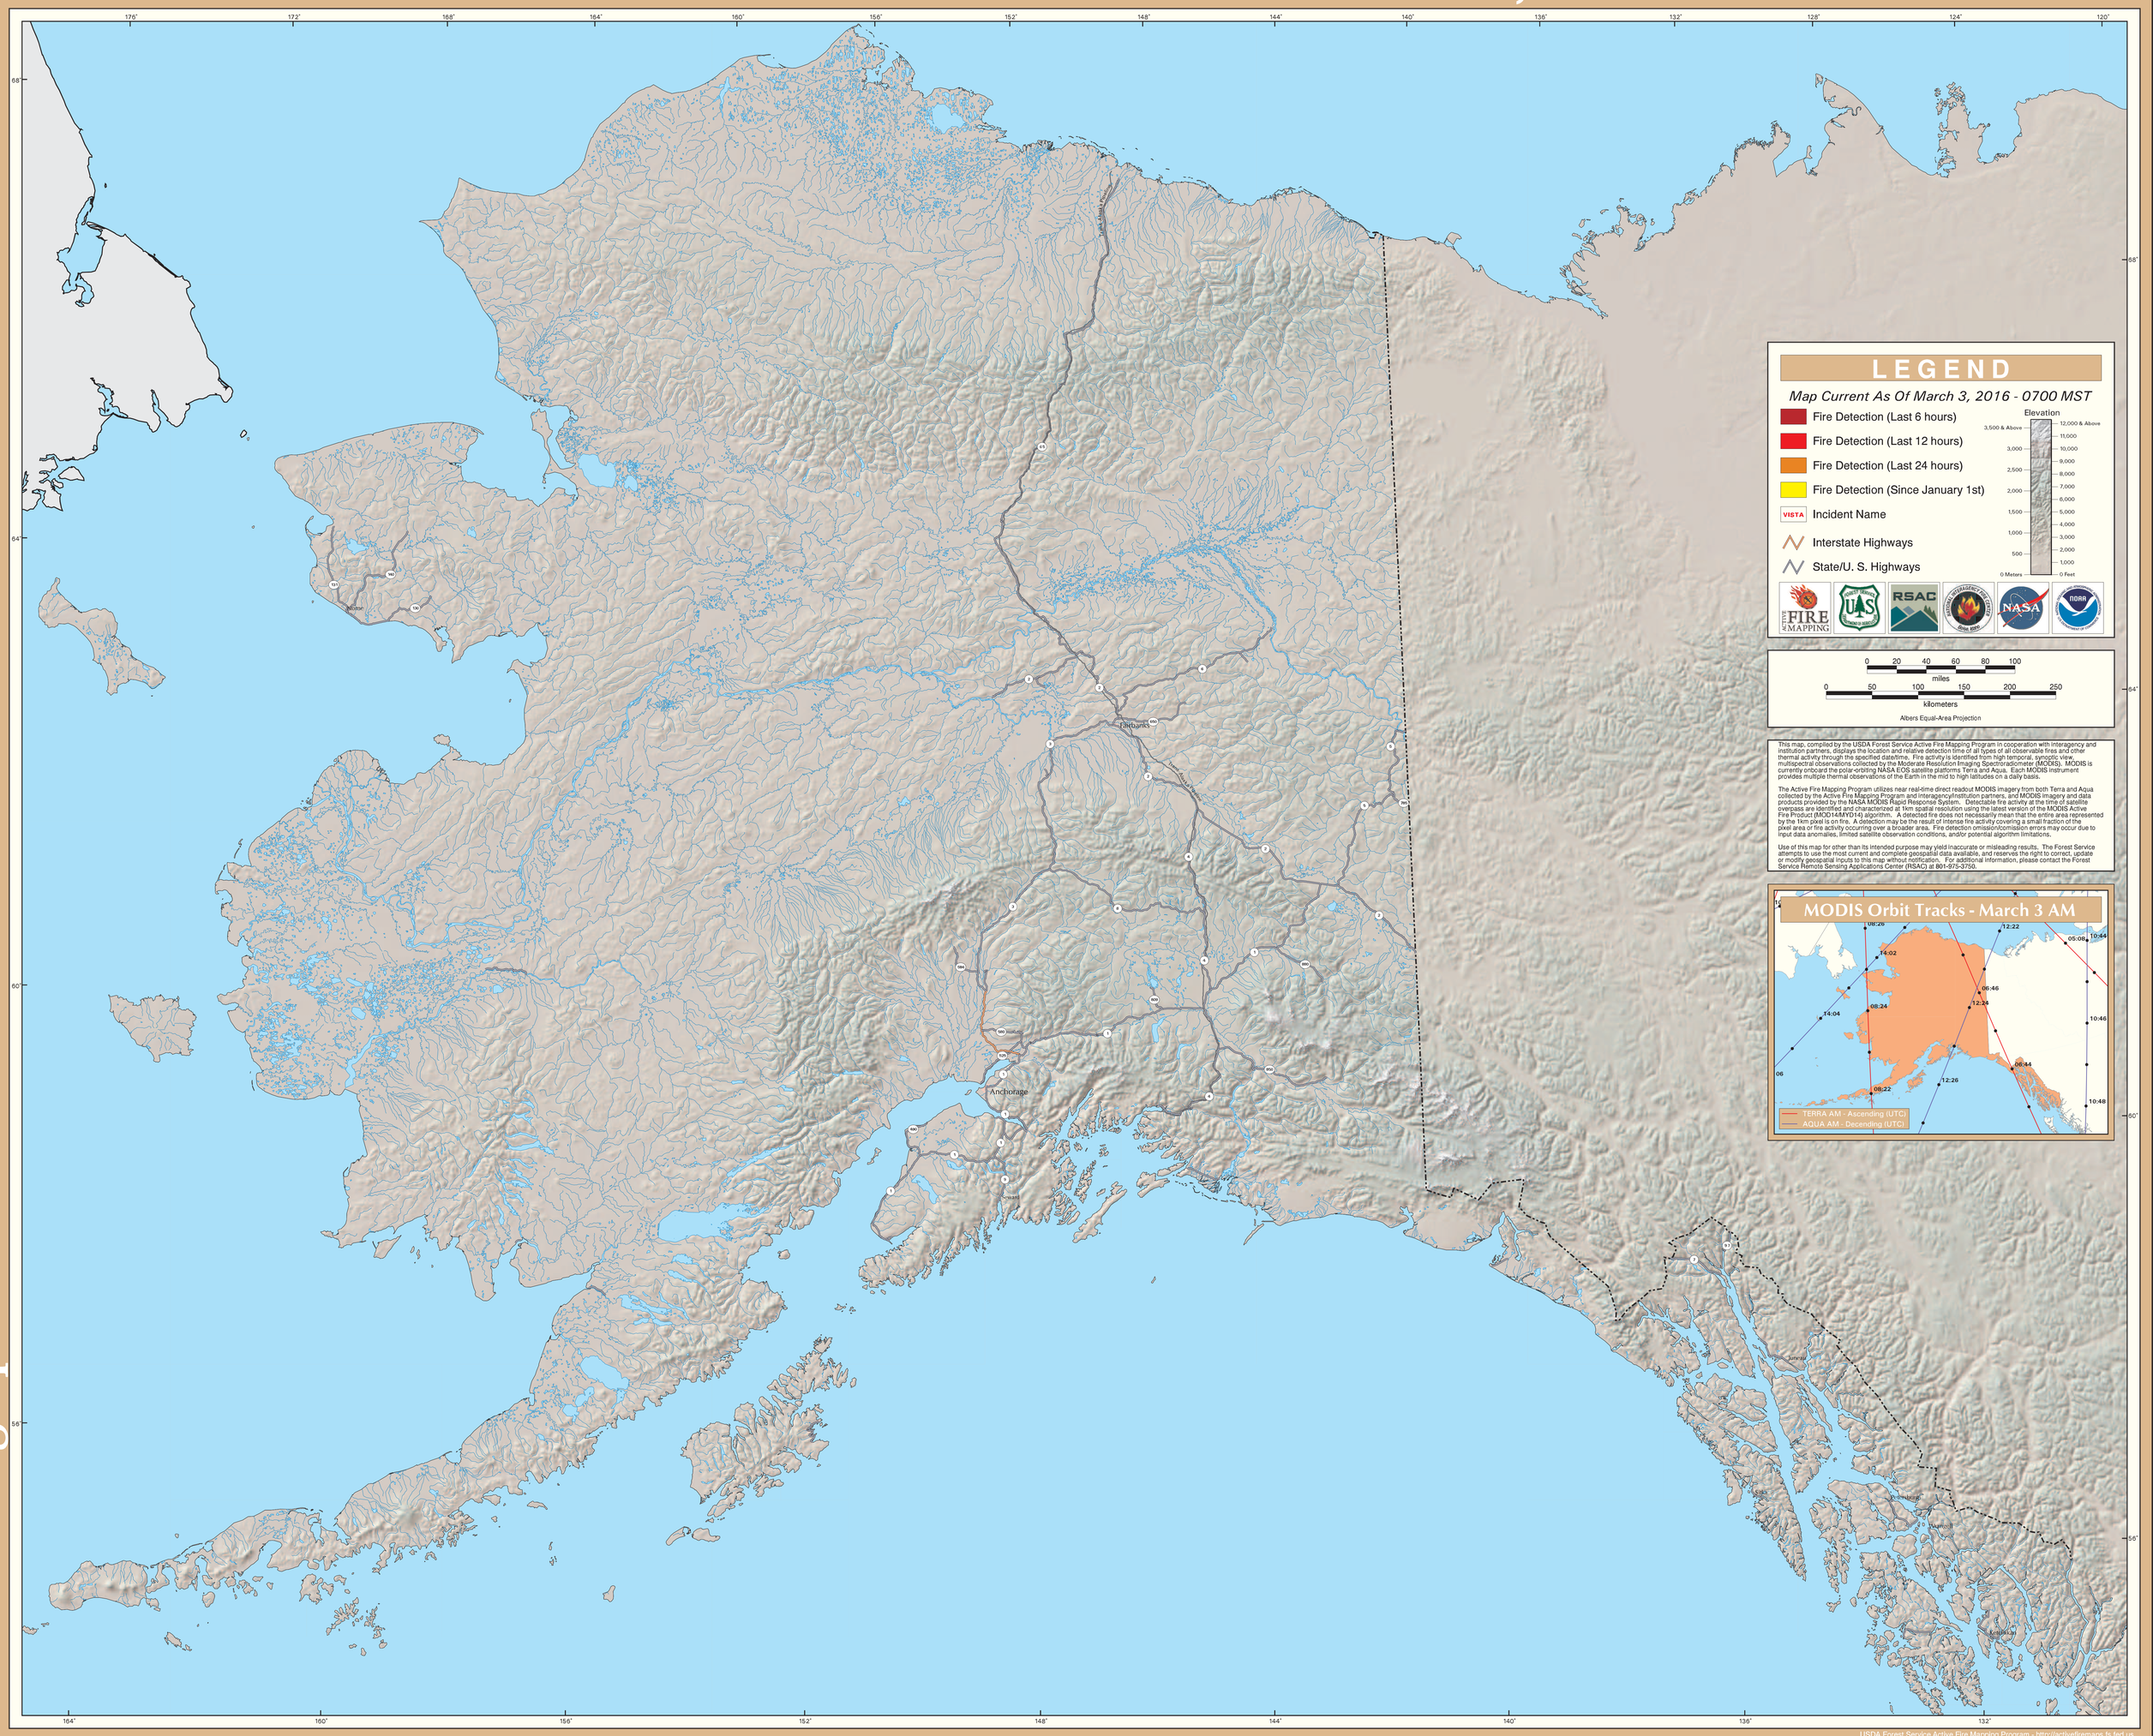MODIS Active Fire Detections - March 3, 2016