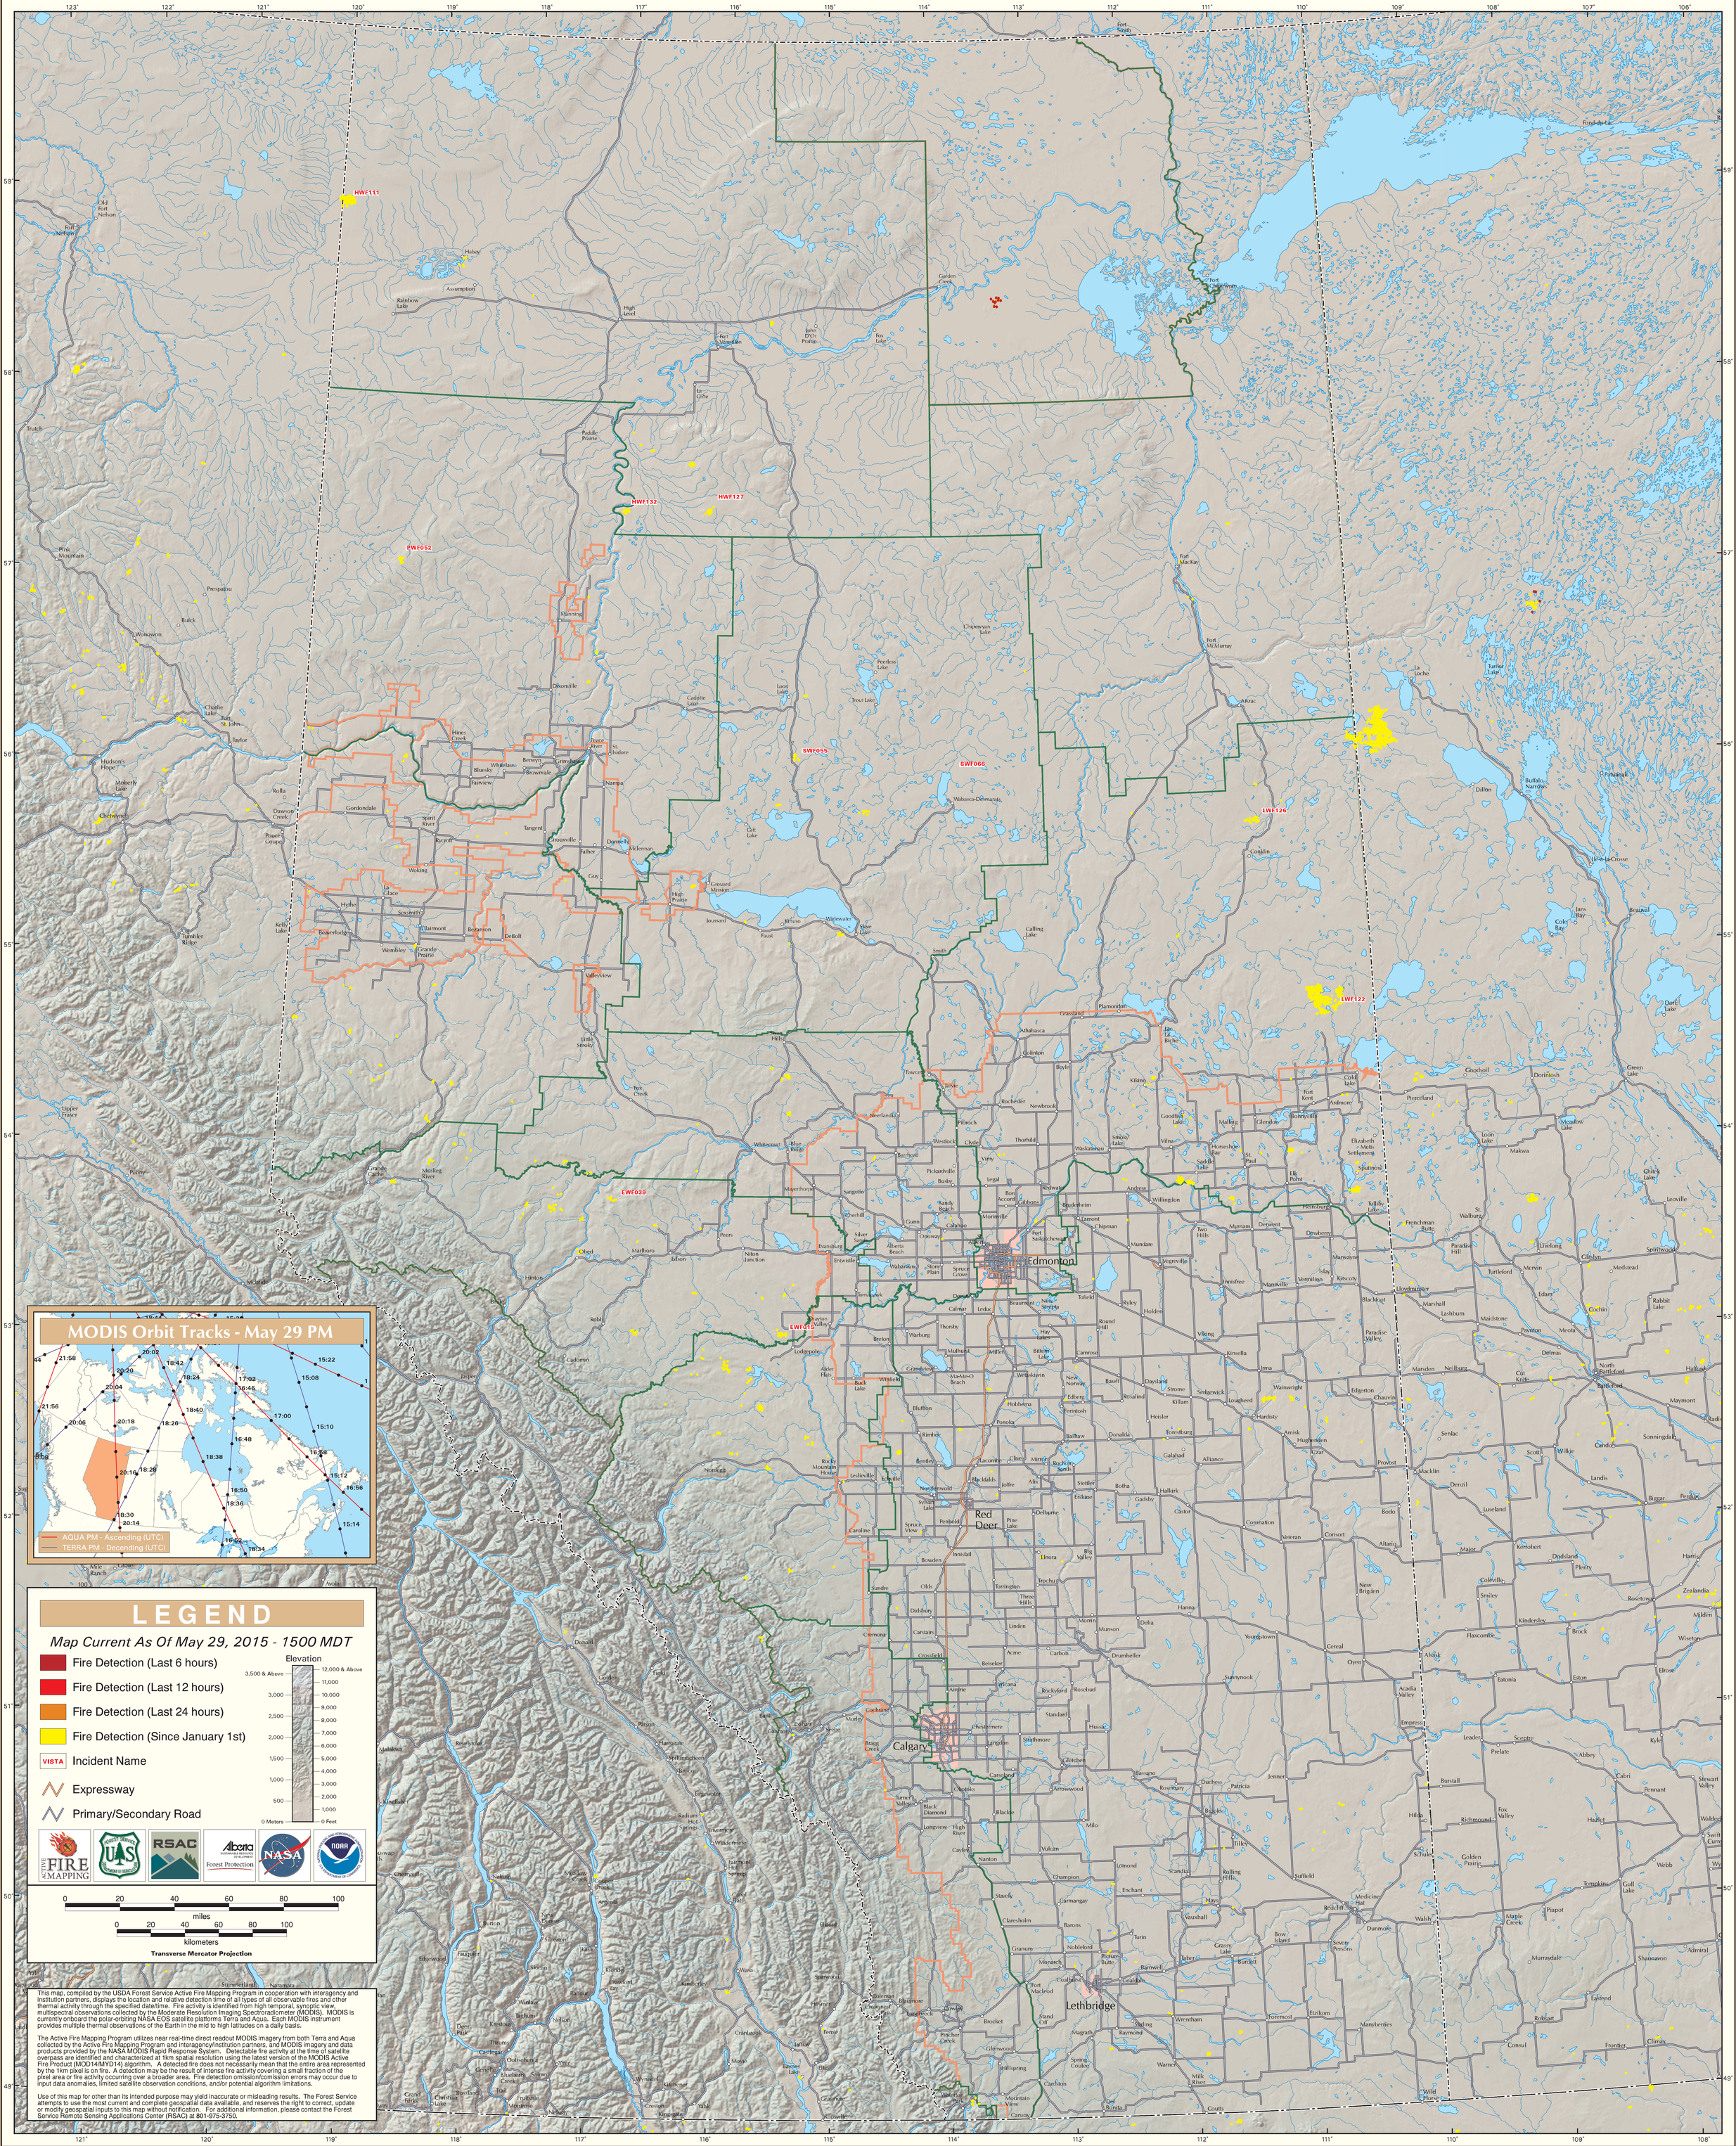MODIS Active Fire Detections - May 29, 2015