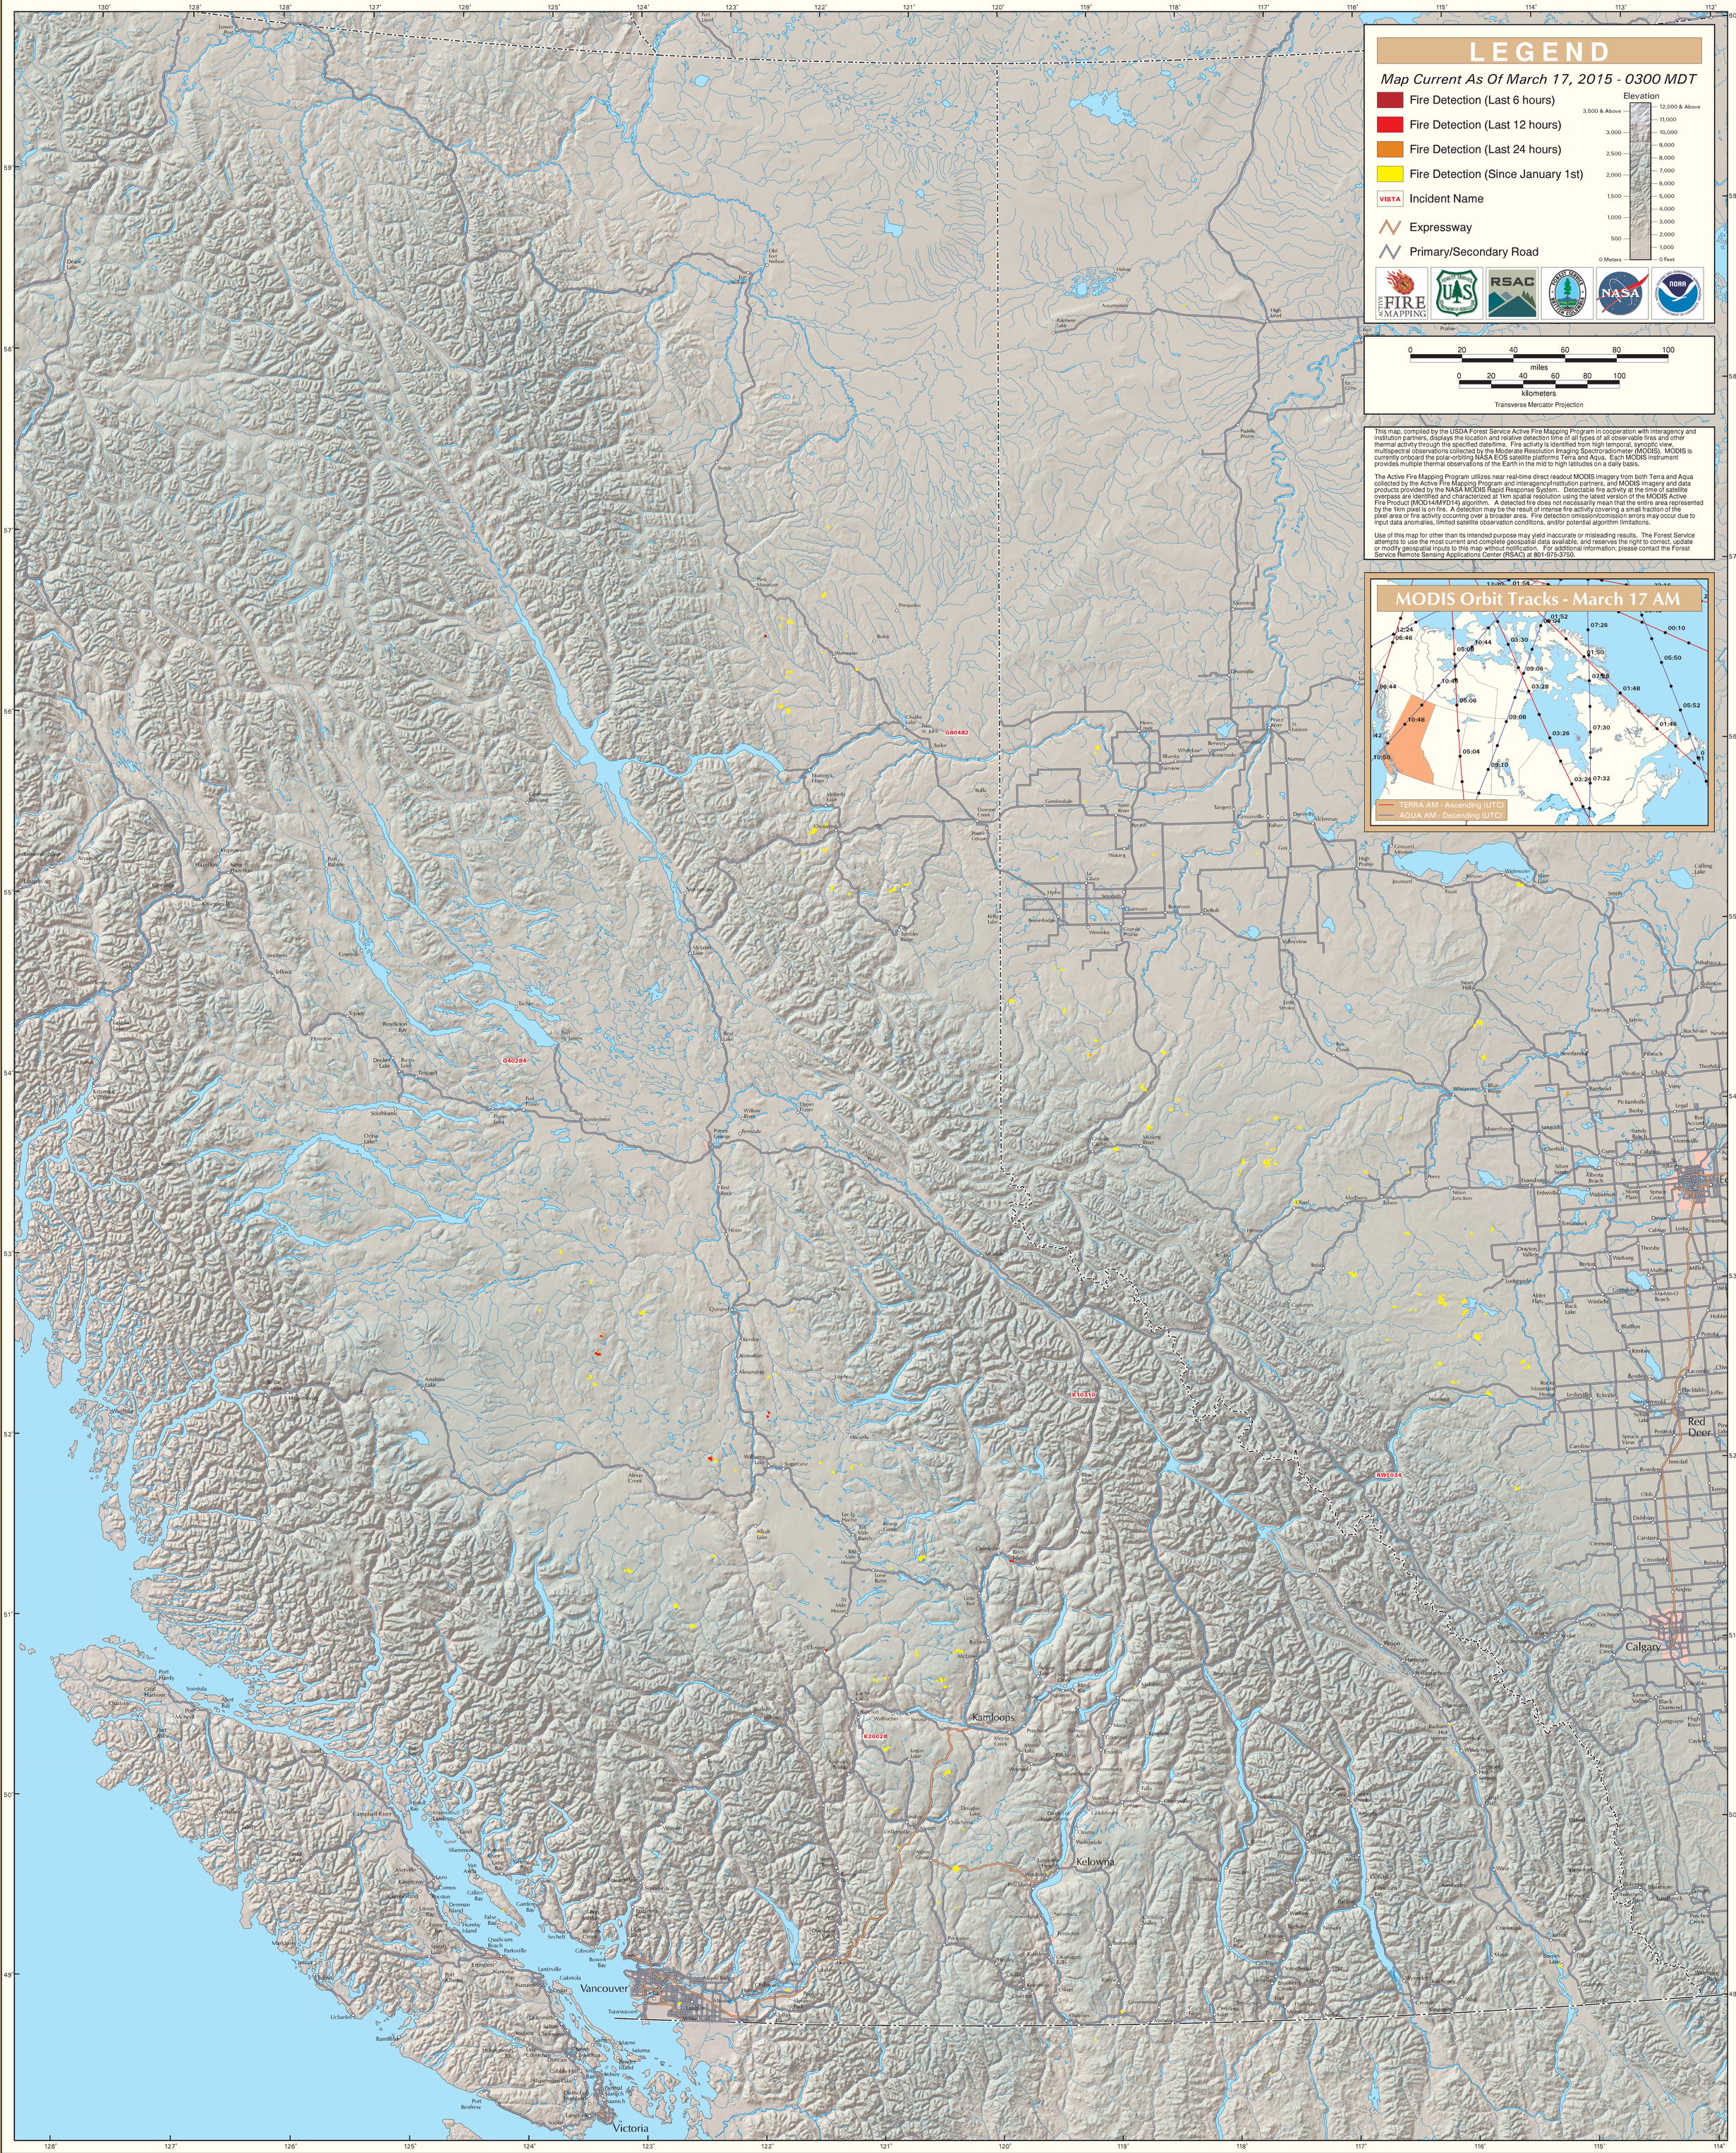MODIS Active Fire Detections - March 17, 2015